


By-Law 2025-015 Schedule A


Page 1 of 2

GENERAL NOTES

1. REFER TO SPECIFICATIONS FOR CONSTRUCTION OF MUNICIPAL DRAINAGE WORKS.
2. ALL ROAD CROSSINGS SHALL BE CONSTRUCTED AS PER THE ABOVE SPECIFICATIONS.
3. DRIVEWAYS SHALL BE REPAIRED AS PER THE ABOVE SPECIFICATIONS.
4. FOR CATCHBASIN CONSTRUCTION, REFER TO CATCHBASIN DETAIL ON THIS PLAN.
5. ALL ROADWAY DITCHES ARE TO BE PROPERLY DITCHED TO NEW CATCHBASINS.
6. ALL ROADWAY CROSSINGS SHALL BE CONSTRUCTED USING C4-69 EXTRA STRENGTH SEWER PIPE

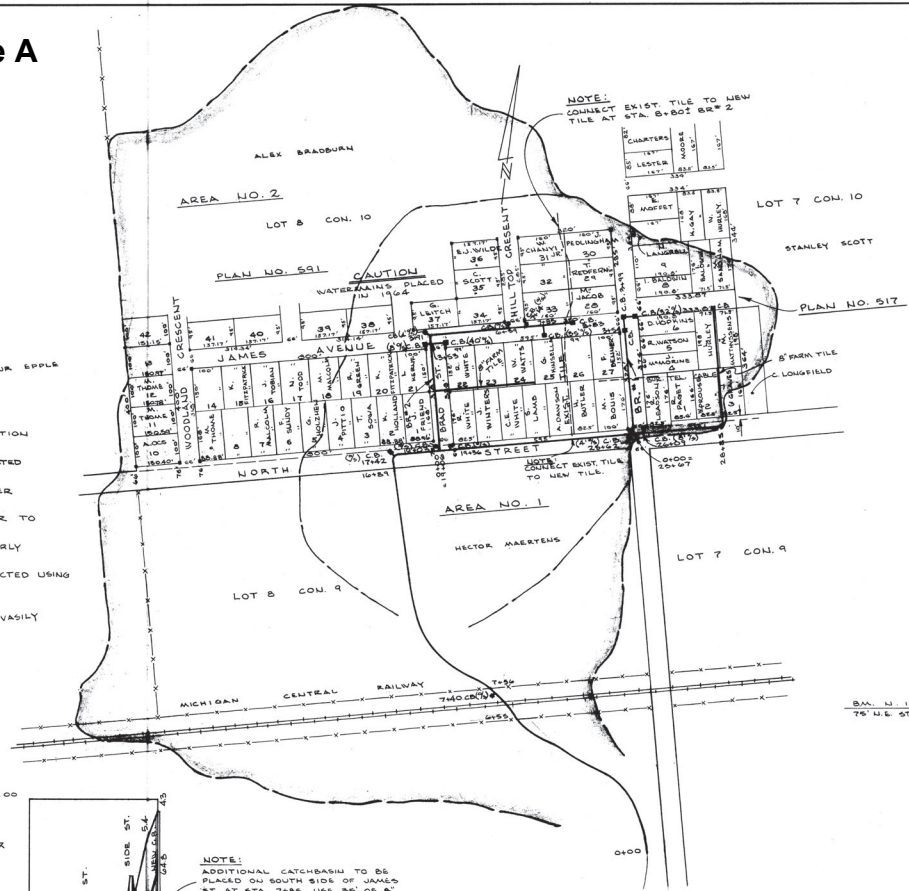


PLAN SCALE 1" = 200'

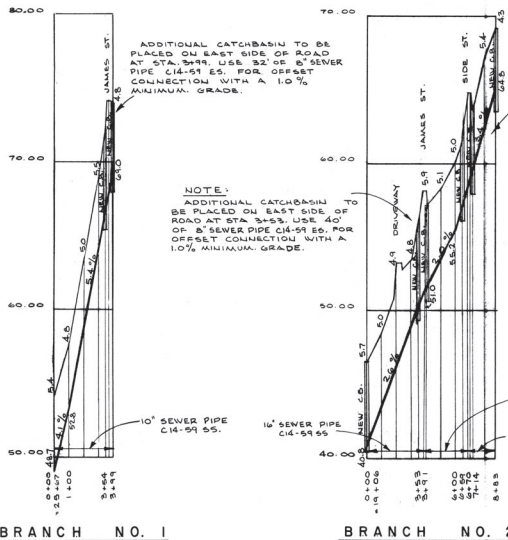


NOTE:
ADDITIONAL CATCHBASIN TO BE PLACED ON SOUTH SIDE OF JAMES ST. AT STA. 785. USE 36" OR 6" SEWER PIPE C4-59 55. FOR OFFSET CONNECTION WITH A 1.0% MINIMUM GRADE.

NOTE:
ADDITIONAL CATCHBASIN TO BE PLACED ON EAST SIDE OF ROAD AT STA. 344. USE 32" OR 6" SEWER PIPE C4-59 55. FOR OFFSET CONNECTION WITH A 1.0% MINIMUM GRADE.

NOTE:
ADDITIONAL CATCHBASIN TO BE PLACED ON EAST SIDE OF ROAD AT STA. 543. USE 40" OR 6" SEWER PIPE C4-59 55. FOR OFFSET CONNECTION WITH A 1.0% MINIMUM GRADE.

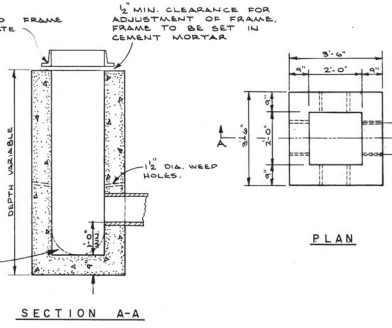

CATCH BASIN

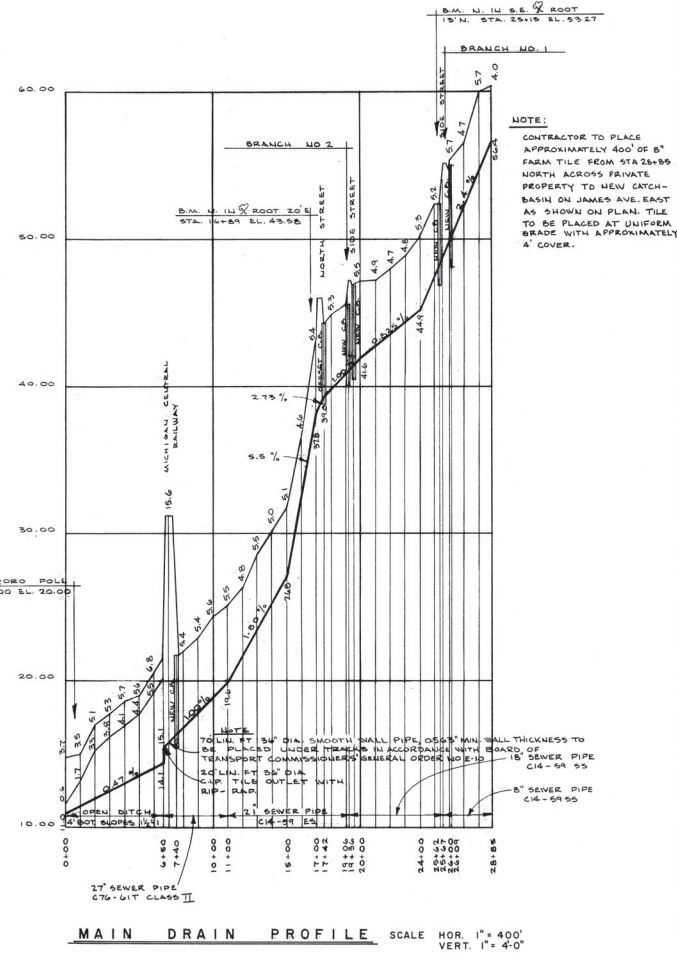

MAIN DRAIN PROFILE SCALE HOR. 1" = 400' VERT. 1" = 4'-0"

- NOTES:**
1. MINIMUM STRENGTH CONCRETE AT 28 DAYS 3000 P.S.I.
 2. TO PERMIT USE OF COLLAPSIBLE FORMS, SEMI-CIRCULAR BOTTOM MAY BE EMPLOYED AT CONTRACTOR'S OPTION
 3. POROUS BACKFILL TO BE PLACED TO A MINIMUM THICKNESS OF 1 FT ON ALL SIDES.

LEGEND

55 - STANDARD STRENGTH
 65 - EXTRA STRENGTH

	REVISED 2-1-66		BRADBURN SUBDIVISION DRAIN	
	TOWNSHIP OF DEREHAM		JOB NO. 6439	
	SCALE: AS SHOWN	APPROVED BY:	DATE: 17/2/05	DRAWN BY: N.E.R.
	A. M. SPRIET & ASSOCIATES LTD.		CONSULTING ENGINEERS	


By-Law 2025-015 Schedule A
 Page 2 of 2



PLAN SCALE 1"=200'

GENERAL NOTES

- REFER TO SPECIFICATIONS FOR CONSTRUCTION OF MUNICIPAL DRAINAGE WORKS.
- ALL ROAD CROSSINGS SHALL BE CONSTRUCTED AS PER THE SPECIFICATIONS.
- DRIVEWAYS SHALL BE REPAIRED AS PER THE ABOVE SPECIFICATIONS.
- FOR CATCHBASIN CONSTRUCTION, REFER TO CATCHBASIN DETAIL ON THIS PLAN.
- ALL SEWER PIPE TO BE EXTRA STRENGTH, BELL & SPIGOT.

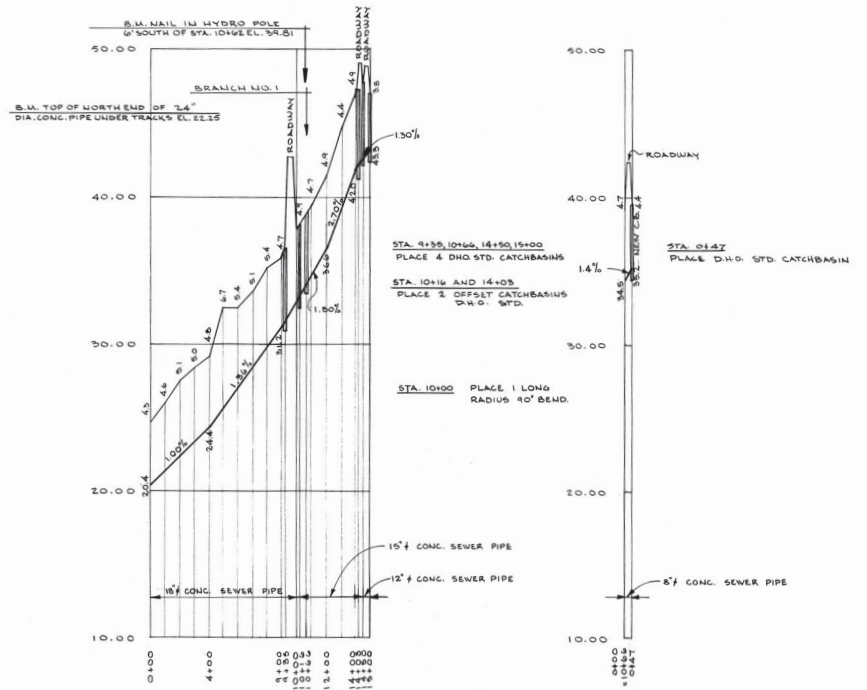


MAIN DRAIN PROFILE

SCALE HORT. 1"=400'
 VERT. 1"=4'-0"

BRANCH NO. 1


SCALE HORT. 1"=400'
 VERT. 1"=4'-0"

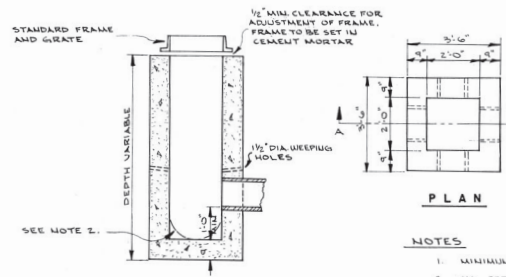

CATCH BASIN DETAIL

NOTES

- MINIMUM STRENGTH CONCRETE AT 28 DAYS 3000 P.S.I.
- TO PERMIT USE OF COLLAPSIBLE FORMS, SEMI-CIRCULAR BOTTOM MAY BE EMPLOYED AT CONTRACTOR'S OPTION.
- POROUS BACKFILL TO BE PLACED TO A MINIMUM THICKNESS OF 1 FT. ON ALL SIDES.



BRADBURN SUBD. DRAIN PHASE 2
 TOWNSHIP OF DEREHAM

SCALE: AS SHOWN	APPROVED BY:	JOB NO. 8533	DRAWN BY: E.A.J.
DATE: 29-10-65			REVISED

PLAN & PROFILES

A. M. SPRIET & ASSOCIATES LTD.
 CONSULTING ENGINEERS

WORKING NUMBER 1